

Attention !

The relays used must be interlocked

F2 = Thermal switch

XS2 = terminal strip 2 pole


XS4 = terminal strip 4 pole

XS6 = terminal strip 6 pole


S10 = Safety isolator switch for emergency hand crank

Options:


- S10 emergency hand crank with push-in isolator switch
- Motor brake 24 Volt/DC + 230 Volt/AC + 400 Volt/AC
- External ventilator with axial fan 230 Volt/AC for Compacta MS12
- Incremental-Encoder / different resolutions on request



Connection



Connection



Connection

External ventilation

Yes

No

Voltage -----

Motor brake

Yes

No

Voltage 230VAC







Incremental-Encoder

Yes

No

Resolutions -----


Connection data refer to supplement

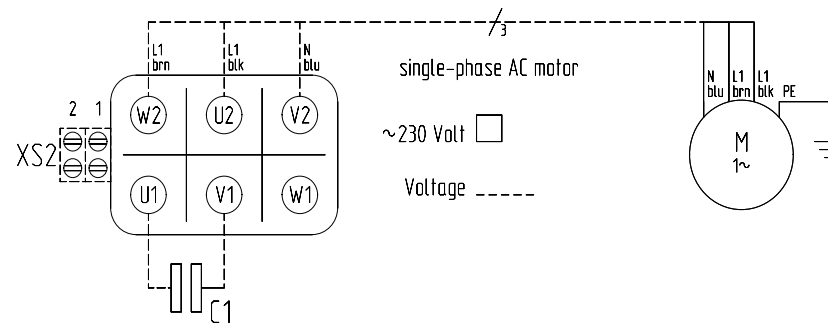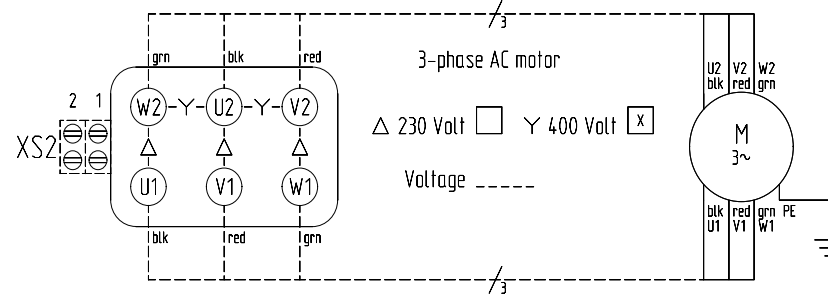

single-phase AC motor

~230 Volt

Voltage -----

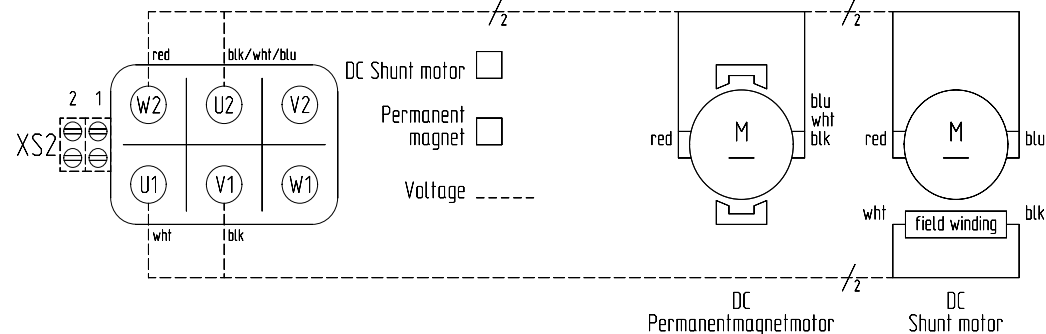

DC Shunt motor

Permanent magnet

Voltage -----

DC Permanentmagnetmotor

DC Shunt motor

Subject to technical changes

			Datum 11.10.2010		Frama Marat GmbH & Co. KG			Version terminal box			Projekt: Compacta		P-No. =c5054		
			Bearb. A.Beha / O.Trenkle		Höchst 7						V-No. +13375				
			Gepr. H.Henster		D-79871 Eisenbach						Projekt Nr. 20000000		Blatt 1		
			www.frama-marat.com		www.frama-marat.com						Zeichnung: c5000.zng		von 1Bl.		
Zustand	Änderung	Datum	Name	Norm	Urspr.	Ers. f.	Ers. d.								
1		2		3		4		5		6		7		8	