


Attention !

The relays used must be interlocked
 Terminal 1 + 2 + 3 = power supply from relay
 Terminal 6 + 9 = safety circuit
 Terminal 11 + 12 = end position
 Terminal 14 + 15 = end position
 External pushbuttons must be wired between terminal 9 + 12 respectively 9 + 15
 Terminal 4 = Earth wire connection / PE

F2 = Thermal switch inside motor winding
 S4 = Safety limit switch for end position S6
 S5 = Safety limit switch for end position S7

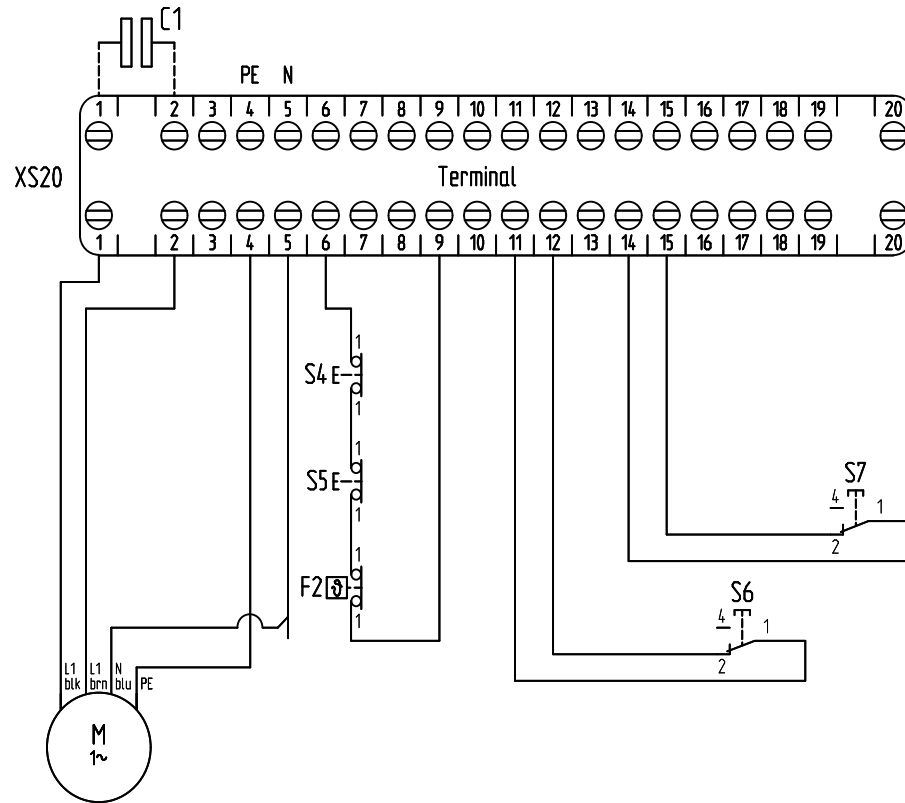

Single-phase AC motor

~230 Volt

Voltage -----

Subject to technical changes

				Datum 27.04.2017		Frama Marat GmbH & Co. KG Höchst 7 D-79871 Eisenbach www.frama-marat.com			Version 12 6-12-MS-BA01			Projekt: Compacta		P-No. =cs12035	
				Bearb. abe / bho										V-No. +	
				Gepr. bho								Projekt Nr. 20000000		Blatt 1	
Zustand	Anderung	Datum	Name	Norm	Urspr.	Ers. f.	Ers. d.				Zeichnung: cs12000.zng		von 1Bl.		